

vibro-meter®

TQ401, EA401 and IQS900 proximity measurement system

TQ401
(with flexible hose)



TQ401 (without flexible hose)



IQS900
signal conditioner
(Images not to scale)



KEY FEATURES AND BENEFITS

- From the vibro-meter® product line
- Non-contact measurement system based on eddy-current principle
- Ex certified versions for use in hazardous areas (potentially explosive atmospheres)
- Conforms to API 670 recommendations
- 5 and 10 m systems
- Temperature-compensated design
- Voltage or current output with protection against short circuits
- Frequency response: DC to 20 kHz (-3 dB)
- Measurement range: 2 mm
- Temperature range: -40 to +180 °C

APPLICATIONS

- Shaft relative vibration and gap/position measurement chains for machinery protection and/or condition monitoring
- Ideal for use with VM600^{Mk2}/VM600 and VibroSmart® machinery monitoring systems

DESCRIPTION

The TQ401, EA401 and IQS900 form a proximity measurement system from Meggitt's vibro-meter® product line. This proximity measurement system allows contactless measurement of the relative displacement of moving machine elements.

TQ4xx-based proximity measurement systems are particularly suitable for measuring the relative vibration and axial position of rotating machine shafts, such as those found in steam, gas and hydraulic turbines, as well as in alternators, turbo-compressors and pumps.



DESCRIPTION (continued)

The system is based around a TQ401 non-contact sensor and an IQS900 signal conditioner. Together, these form a calibrated proximity measurement system in which each component is interchangeable. The system outputs a voltage or current proportional to the distance between the transducer tip and the target, such as a machine shaft.

The active part of the transducer is a coil of wire that is moulded inside the tip of the device, made of Torlon[®] (polyamide-imide). The transducer body is made of stainless steel. The target material must, in all cases, be metallic.

The transducer body is available with metric or imperial thread. The TQ401 has an integral coaxial cable, terminated with a self-locking miniature coaxial connector. Various cable lengths (integral and extension) can be ordered.

The IQS900 signal conditioner contains a high-frequency modulator/demodulator that supplies a driving signal to the transducer. This generates the necessary electro-magnetic field used to measure the gap. The conditioner circuitry is made of high-quality components and is mounted in a painted aluminium housing.

Note: The IQS900 signal conditioner matches or better the outstanding measurement performance

and specifications of the IQS450 signal conditioner, which it replaces. Accordingly, the IQS900 is compatible with all TQ9xx and TQ4xx proximity sensors / measurement chains.

In addition, the IQS900 signal conditioner includes improvements such as: SIL 2 “by design”, improved frame-voltage immunity, improved electromagnetic immunity and emissions, smaller output impedance (voltage output), optional diagnostic circuitry (that is, built-in self-test (BIST)), raw output pin, test input pin, new DIN-rail mounting adaptor and removable screw-terminal connectors for easier installation.

The TQ401 transducer can be matched with a single EA401 extension cable to effectively lengthen the front-end. Optional housings, junction boxes and interconnection protectors are available for the mechanical and environmental protection of the connection between the integral and extension cables.

TQ4xx-based proximity measurement systems can be powered by associated machinery monitoring systems such as VM600^{Mk2}/VM600 modules (cards) or VibroSmart[®] modules, or by another power supply.

For specific applications, contact your local Parker Meggitt representative.

SPECIFICATIONS

Overall proximity measurement system

Operation

Sensitivity

- Ordering option B11 : 8 mV/μm (200 mV/mil)
- Ordering option B12 : 2.5 μA/μm (62.5 μA/mil)

Linear measurement range (typical)

- Ordering option B11 : 0.2 to 2.2 mm, corresponding to a –1.6 to –17.6 V output
- Ordering option B12 : 0.2 to 2.2 mm, corresponding to a –15.5 to –20.5 mA output

Linearity : See **Performance curves on page 8**



Frequency response : DC to 20 kHz (–3 dB)



Interchangeability of elements : All components in system are interchangeable

SPECIFICATIONS (continued)

Environmental Potentially explosive atmospheres

Available in Ex approved versions for use in hazardous locations – TQ401 and EA401

Type of protection Ex i: intrinsic safety (ordering option A2)		
Europe	EC type examination certificate	 II 1G (Zones 0, 1, 2) LCIE 11 ATEX 3091 X Ex ia IIC T6...T3 Ga
International	IECEx certificate of conformity	IECEx LCI 11.0061X Ex ia IIC T6...T3 Ga
North America	cCSAus certificate of compliance	cCSAus 1514309 Class I, Divisions 1 and 2, Groups A, B, C, D Ex ia
South Korea	KGS certificate of conformity	KGS 15-GA4BO-0664X Ex ia IIC T6 to T3
Russian Federation	EAЭC RU certificate of conformity	EAЭC RU C-CH.AД07.B.03003/21  0Ex ia IIC T6...T3 Ga X

Type of protection Ex nA: non-sparking (ordering option A3)		
Europe	Voluntary type examination certificate	 II 3G (Zone 2) LCIE 11 ATEX 1010 X Ex nA II T6...T3 Gc
International	IECEx certificate of conformity	IECEx LCI 11.0063X Ex nA II T6...T3 Gc
North America	cCSAus certificate of compliance	cCSAus 1514309 Class I, Division 2, Groups A, B, C, D
Russian Federation	EAЭC RU certificate of conformity*	EAЭC RU C-CH.AД07.B.03003/21  2Ex nA II T6...T3 Gc X

* Not engraved/marked on the products.

 **For specific parameters of the mode of protection concerned and special conditions for safe use, refer to the Ex certificates that are available from Parker Meggitt.**

 **For the most recent information on the Ex certifications that are applicable to this product, refer to the Ex product register (PL-1511) document that is available from Parker Meggitt.**

SPECIFICATIONS *(continued)*

Available in Ex approved versions for use in hazardous areas – IQS9xx (ordering option code A5)




Protection mode	IQS9xx
Europe	
ec (Gas)	Ⓔ _x II 3 G (Zone 2) Ex ec IIC T6 or T5 Gc LCIE 21 ATEX 1004 X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Gas)	Ⓔ _x II 1 G (Zones 0, 1, 2) Ex ia IIC T6 or T5 Ga LCIE 21 ATEX 3002 X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Dust)	Ⓔ _x II 1 D (Zones 20, 21, 22) Ex ia IIIC T ₂₀₀ 80°C... T ₂₀₀ 115°C Da LCIE 21 ATEX 3002 X T ₂₀₀ 80°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +50^{\circ}\text{C}$ T ₂₀₀ 95°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +65^{\circ}\text{C}$ T ₂₀₀ 115°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
International	
ec (Gas)	Ex ec IIC T6 or T5 Gc IECEx LCIE 21.0005X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Gas)	Ex ia IIC T6 or T5 Ga IECEx LCIE 21.0006X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Dust)	Ex ia IIIC T ₂₀₀ 80°C... T ₂₀₀ 115°C Da IECEx LCIE 21.0006X T ₂₀₀ 80°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +50^{\circ}\text{C}$ T ₂₀₀ 95°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +65^{\circ}\text{C}$ T ₂₀₀ 115°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$

SPECIFICATIONS (continued)

Protection mode	IQS9xx
North America	
ec (Gas)	Class I, Division 2, Groups A, B, C, D T6... T5 Ex ec IIC T6... T5 Gc Class I, Zone 2, AEx ec IIC T6... T5 Gc cCSAus 80084516
ia (Gas)	IS Class I, Division 1, Groups A, B, C, D T6 or T5 Ex ia IIC T6 or T5 Ga Class I, Zone 0, AEx ia IIC T6 or T5 Ga cCSAus 80084516
ia (Dust)	Class II, Division 1, Groups E, F, G T80°C... T115°C Ex ia IIIC T80°C... T115°C Da Zone 20, AEx ia IIIC T80°C... T115°C Da cCSAus 80084516
South Korea	
ec (Gas)	Ex ec IIC T6... T5 Gc KGS 24-GA4BO-0436X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Gas)	Ex ia IIC T6 or T5 Ga KGS 24-GA4BO-0437X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Dust)	Ex ia IIIC T ₂₀₀ 80°C... T ₂₀₀ 115°C Da KGS 24-GA4BO-0438X T ₂₀₀ 80°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +50^{\circ}\text{C}$ T ₂₀₀ 95°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +65^{\circ}\text{C}$ T ₂₀₀ 115°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
United Kingdom*	
ec (Gas)	Ⓔ II 3 G (Zone 2) Ex ec IIC T6 or T5 Gc CML 21 UKEX 4549 X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Gas)	Ⓔ II 1 G (Zones 0, 1, 2) Ex ia IIC T6 or T5 Ga CML 21 UKEX 2548 X T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Dust)	Ⓔ II 1 D (Zones 20, 21, 22) Ex ia IIIC T ₂₀₀ 80°C... T ₂₀₀ 115°C Da CML 21 UKEX 2548 X T ₂₀₀ 80°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +50^{\circ}\text{C}$ T ₂₀₀ 95°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +65^{\circ}\text{C}$ T ₂₀₀ 115°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
*UKCA marking is not engraved/marked on the products.	

SPECIFICATIONS (continued)

Protection mode	IQS9xx
Kazakhstan (Eurasian Economic Union)	
ec (Gas)	[X] 2Ex e IIC T6... T5 Gc X EAЭC KZ 7100841.01.01.03722 T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Gas)	[X] 0Ex ia IIC T6... T5 Ga X EAЭC KZ 7100841.01.01.03722 T6: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +70^{\circ}\text{C}$ T5: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
ia (Dust)	[X] Ex ia IIIC T ₂₀₀ 80°C... T ₂₀₀ 115°C Da X EAЭC KZ 7100841.01.01.03722 T ₂₀₀ 80°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +50^{\circ}\text{C}$ T ₂₀₀ 95°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +65^{\circ}\text{C}$ T ₂₀₀ 115°C: For $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$

-  **For specific parameters of the mode of protection concerned and special conditions for safe use, refer to the Ex certificates that are available from Parker Meggitt.**
-  **For an IQS9xx signal conditioner with protection mode “Ex ec” located in an Ex Zone 2, the user must ensure that the IQS9xx is installed in an industrial housing or enclosure that ensures a protection rating of at least IP54 (or equivalent).**
-  **For the most recent information on the Ex certifications that are applicable to the IQS900, refer to the *Ex product register (PL-1511)* document that is available from Parker Meggitt. For information on the IQS910’s Ex certifications, refer to the *IQS910 signal conditioner data sheet*.**

Approvals

Conformity	: European Union (EU) declaration of conformity (CE marking). Eurasian Economic Union certificate/declaration of conformity (EAC marking).
Electromagnetic compatibility	
• TQ401 and EA401	: EN 61000-6-2:2005. EN 61000-6-4:2007 + A1:2011. TR CU 020/2011.
• IQS900	: EN 61000-6-2:2005. EN 61000-6-4:2007 + A1:2011. EN 61326-1:2013. EN 61326-3-2:2008 (SIL).
Electrical safety	: EN 61010-1:2010
Environmental management	: RoHS compliant (2011/65/EU)
Hazardous areas	: Ex approved versions (see Potentially explosive atmospheres starting on page 3)
Functional safety	: SIL 2 in accordance with IEC 61508-1:2010 and IEC 61508-2:2010. Cat 1 PL c in accordance with ISO 13849-1:2015.

SPECIFICATIONS *(continued)*

System (chain) calibration

Calibration temperature	: +23°C ±5°C
Target material	: VCL 140 steel (1.7225)

Note: For applications using a non-standard or special target material, performance curves can be generated and supplied. Contact Parker Meggitt. for further information.

Total system (chain) length

The total system length (TSL) is the sum of the length of the TQ4xx transducer's integral cable and the length of the EA40x extension cable. The supported TSLs can be obtained from different combinations of cables.

Total system lengths

• 5 m	: 0.5 m integral cable + 4.5 m extension cable.
	1.0 m integral cable + 4.0 m extension cable.
	1.5 m integral cable + 3.5 m extension cable.
	2.0 m integral cable + 3.0 m extension cable.
	5.0 m integral cable with no extension cable.
• 10 m	: 0.5 m integral cable + 9.5 m extension cable.
	1.0 m integral cable + 9.0 m extension cable.
	1.5 m integral cable + 8.5 m extension cable.
	2.0 m integral cable + 8.0 m extension cable.

Note: The combination of cables selected for a particular total system length depends on the application. For example, to obtain the optimum location for the separation between the integral and extension cables or to eliminate the requirement for an extension cable.

Total system (chain) length trimming


Due to the characteristics of the coaxial cable, an "electrical trimming" of the nominal length of extension cables is necessary to optimize the system performance and the transducer interchangeability.

TSL for a 5 m measurement chain	: 4.4 m minimum
TSL for a 10 m measurement chain	: 8.5 m minimum



SPECIFICATIONS (continued)

Performance curves for TQ401 with IQS900

Typical gap error (μm)
 (Referenced to 8 mV/ μm
 (2.5 $\mu\text{A}/\mu\text{m}$) line)

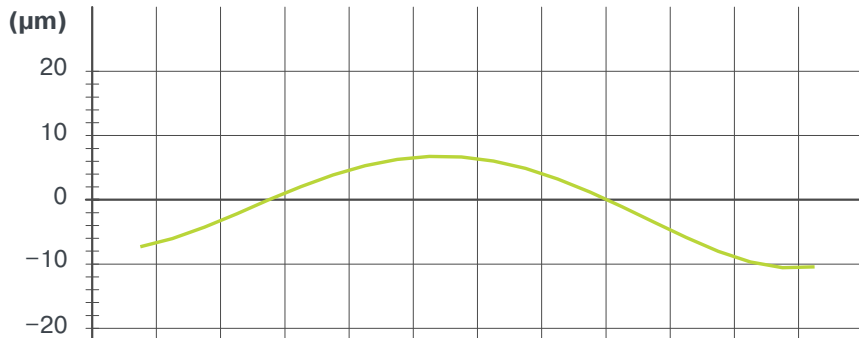

Typical sensitivity error (%)
 (Referenced to 8 mV/ μm
 (2.5 $\mu\text{A}/\mu\text{m}$))

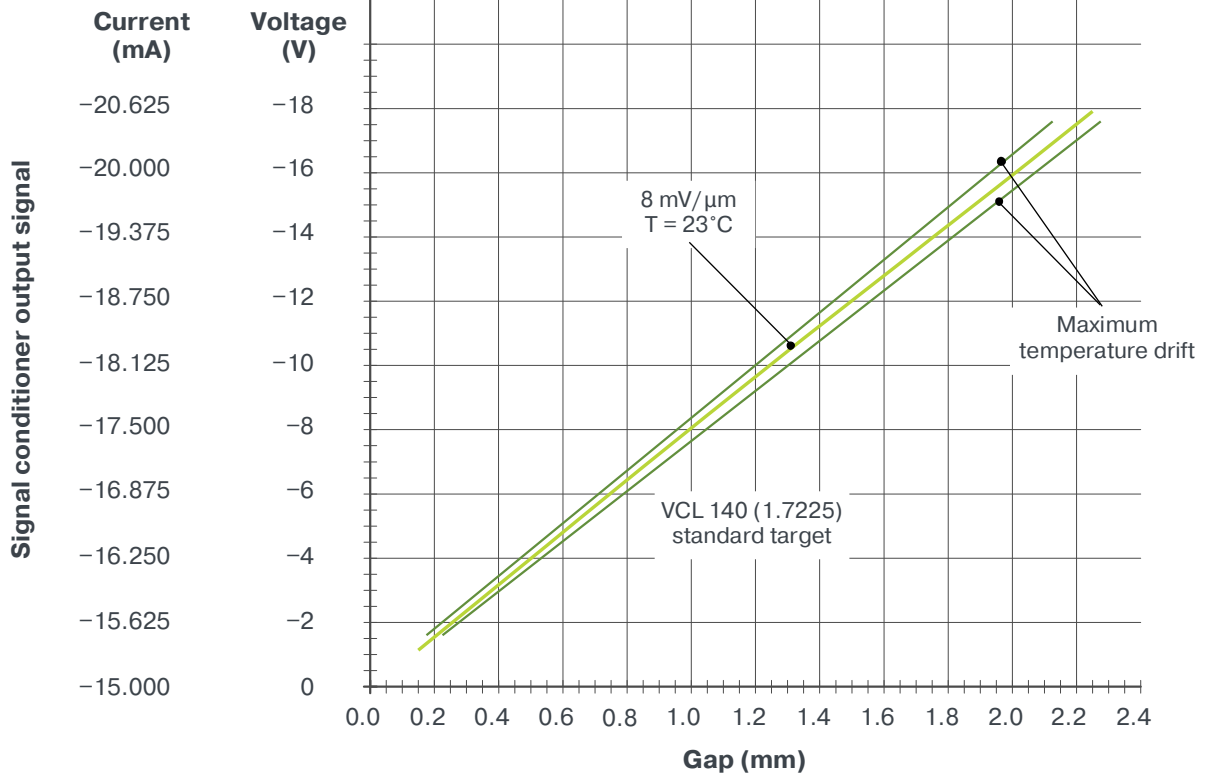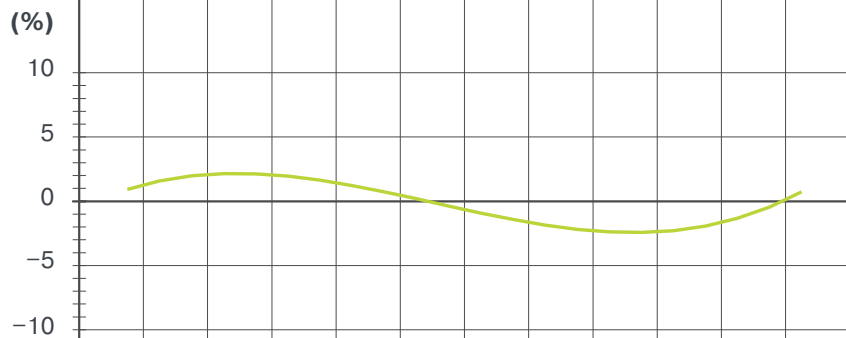

Proximity transducer: TQ401
 Signal conditioner: IQS900
 Standard target material: VCL 140 (1.7225)
 Equivalent materials: A 37.11 (1.0065), AFNOR 40 CD4, AISI 4140

SPECIFICATIONS *(continued)*

TQ401 proximity transducer and EA401 extension cable

General

Transducer input requirements : High-frequency power source from a IQS9XX signal conditioner

Environmental

Temperature range

- Transducer : -40 to +180°C with drift < 5% (operating).
+180 to +220°C with drift > 5% (short-term survival).
 - Transducer and cable : -40 to +195°C if used in an Ex Zone
 - Cable and connector : -40 to +200°C
 - Heat-shrinkable sleeve : -40 to +135°C
- Protection rating (according to IEC 60529) : The head of the proximity transducer (transducer tip and integral cable) is rated IP68
- Vibration (according to IEC 60068-2-26) : 5 g peak between 10 and 500 Hz
- Shock acceleration (according to IEC 60068-2-27) : 15 g peak (half sine-wave, 11 ms duration)

Physical characteristics

- Transducer construction : Wire coil Ø5 mm, Torlon (polyamide-imide) tip, encapsulated in stainless steel body (AISI 316L) with high-temperature epoxy glue
- Integral and extension cables : FEP covered 50 Ω coaxial cable, Ø2.65 or Ø3.6 mm
- Connectors : Self-locking miniature coaxial connectors.
Note: When connecting, these should be hand-tightened until locked.
- Optional protection
- Flexible stainless steel hose (protection tube) : The stainless steel hose provides additional mechanical protection but is not leak-tight
 - Heat-shrinkable sleeve (modified Polyolefin) : The heat-shrinkable sleeve provides additional mechanical and electrical protection

SPECIFICATIONS (continued)

IQS900 signal conditioner

Current output (2-wire signal transmission)

Current at min. / max. gap	: -15.5 mA / -20.5 mA
Measurement range	: 5 mA (corresponding to 2 mm)
Output sensitivity	: See Operation on page 2 and IQS900 signal conditioner on page 15
Nominal output signal	
• Without diagnostics	: -15.5 to -20.5 mA
• With diagnostics	: -15.5 to -20.5 mA indicates normal operation. Other current values (>-15.5 or <-20.5 mA) indicate a problem with the measurement chain (sensor, cabling and/or signal conditioner).
Output impedance	: >60 k Ω . Note: Recommended monitoring system input impedance: ≤ 350 Ω .

Voltage output (3-wire signal transmission)

Voltage at min. / max. gap	: -1.6 V / -17.6 V
Measurement range	: 16 V (corresponding to 2 mm)
Output sensitivity	: See Operation on page 2 and IQS900 signal conditioner on page 15
Nominal output signal	
• Without diagnostics	: -1.6 to -17.6 V
• With diagnostics	: -1.6 to -17.6 V indicates normal operation. Other current values (>-1.6 or <-17.6 V) indicate a problem with the measurement chain (sensor, cabling and/or signal conditioner).
Output impedance (small signal)	: < 100 Ω at DC. < 300 Ω at 20 kHz. Note: Recommended monitoring system input impedance: ≥ 50 k Ω . The low output impedance enables operation with a wider range of galvanic separation units / safety barriers, without loss of performance. For example, an IQS900 (output impedance 100 Ω) connected to a third-party galvanic isolator (input impedance 10 k Ω) will see 1% max. signal loss due to impedance matching.
Protection	: Short-circuit (35 mA), overvoltage (-33 V _{DC} typical)
Output voltage swing	: -0.05 to -22.5 V with a 50 k Ω load and a -24 V _{DC} power supply. -0.05 to -21.5 V with a 10 k Ω load and a -24 V _{DC} power supply.

Raw output (RAW/COM)

Output voltage range	: -0.8 to -8.8 V (nominal)
Output impedance	: < 15 k Ω up to 20 kHz. < 10 k Ω for DC measurement. Note: Recommended test equipment input impedance: > 1 M Ω .
Protection	: Short-circuit, overvoltage (-33 V _{DC} typical)

SPECIFICATIONS *(continued)*

Test input (TEST/COM)

Input voltage range	: ± 0.1 to $4.0 V_{PK-PK}$ (nominal), depending on the measured gap (DC)
Input impedance	: $500 \text{ k}\Omega$. Note: Recommended test equipment output impedance: $> 5 \text{ k}\Omega$.
Protection	: Overvoltage ($-33 V_{DC}$ typical)

Power supply (to IQS900)

Input voltage range	
• With a current output signal (2-wire signal transmission)	: -18 to $-30 V_{DC}$ (nominal)
• With a voltage output signal (3-wire signal transmission)	: -19 to $-30 V_{DC}$ (nominal)
Current consumption (with nominal $24 V_{DC}$ supply)	: 25 mA max.
Overvoltage protection (diode)	: $-33 V_{DC}$ typical

Note: The IQS900 should be powered (energised) using a limited-power, low-voltage power supply such as a sensor power supply output provided a VM600^{Mk2}/VM600 or VibroSmart[®] monitoring and/or protection system, a GSI127 galvanic separation unit or other suitable power supply.

In safety-related applications, an IQS900 must be powered using a limited-power, low-voltage power supply with a safe limitation of $-30 V_{DC}$ (nominal), even in the event of a single fault with the power supply.

Environmental

Temperature	
• Operating and storage	: -40 to 85°C (-40 to 185°F)
Humidity	: 0 to 95% , non-condensing
Protection rating (according to IEC 60529)	: IP20. Note: The IQS900 is suitable for indoor use only unless it is installed in an industrial housing or enclosure that ensures a higher level of environmental protection.
Flammability	: UL94 V-0
Vibration (according to IEC 60068-2-6)	: 5 g peak between 10 and 500 Hz
Shock acceleration (according to IEC 60068-2-27)	: 15 g peak (half sine-wave, 11 ms duration)

SPECIFICATIONS *(continued)*

Connectors

Self-locking miniature coaxial connector (bidirectional)	: 1 contact for sensor-side signal: sensor (connects to TQ9xx sensor or EA902 cable)
Screw-terminal connector (input)	: 4 contacts for test signals: raw output (RAW/COM) and test input (TEST/COM)
Screw-terminal connector (output)	: 4 contacts for monitor-side signals: measurement output (O/P/COM) and power supply input (-24V/COM)
Screw-terminal connectors	
• Clamping range (min. to max.)	: 0.2 to 1.5 mm ² (24 to 16 AWG)
• Tightening torque (min. to max.)	: 0.2 to 0.25 N·m (0.15 to 0.18 lb-ft)


Note: The IQS900 features removal screw-terminal connectors that can unplugged from the main body of its housing to simplify installation and mounting.

Physical characteristics

Electrical connections	: Self-locking miniature coaxial connector and removable screw-terminal connectors (see Connectors on page 12)
Housing material	: Injection-moulded aluminium, painted
Dimensions	: See Mechanical drawings and ordering information on page 15
Weight	: 200 g (0.44 lb) approx.
Mounting	
• Without DIN-rail mounting adaptor	: Two M4 screws
• With DIN-rail mounting adaptor (ordering option code G2)	: MA130 DIN-rail mounting adaptor for IPC707 and IQS900 signal conditioners. Suitable for TH 35 DIN rails (according to EN 50022 / IEC 60715). For example, TH 35-7.5 or TH 35-15. See Accessories on page 16 .

MECHANICAL DRAWINGS AND ORDERING INFORMATION

TQ401 proximity transducer

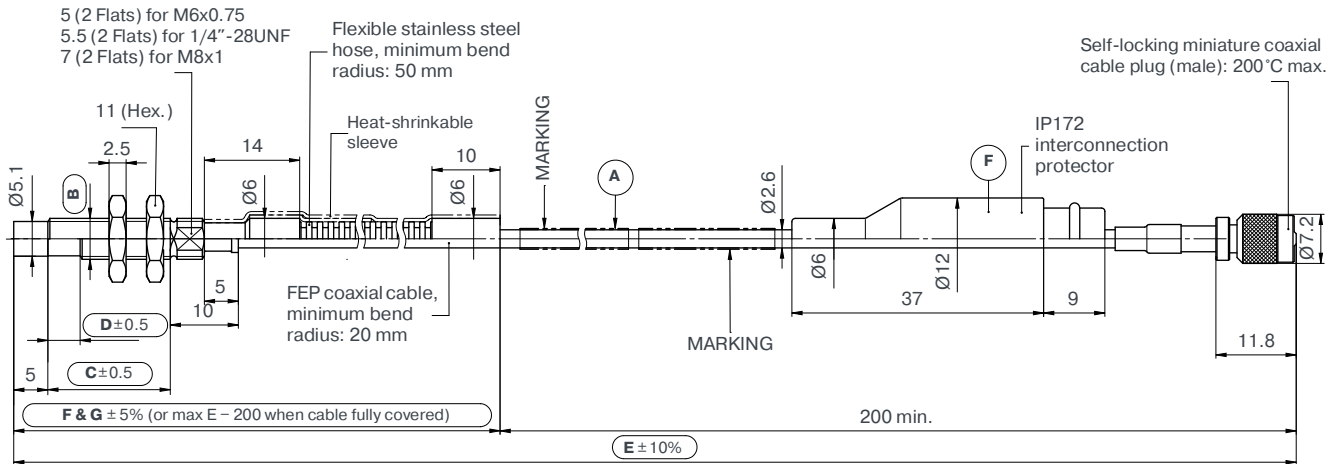

Ordering number:

111 - 401 - 000 - 013 **A** **B** **C** **D** **E** **F** **G** **H**

Environment (A)	
Standard	1
Explosive Ex i	2
Explosive Ex nA	3

Body thread (B)	
M6 x 0.75	1
M8 x 1	2
1/4" -28UNF	6

Body length (C)	
Each 1 mm, from 18 to 250 mm	
18 mm min.	018
250 mm max.	250

Unthreaded length (D)	
Each 1 mm, from 0 to 60 mm	
0 mm min.	000
60 mm max.	060

Integral cable length (E)	
0.5 m ± 50 mm	005
1.0 m ± 100 mm	010
1.5 m ± 150 mm	015
2.0 m ± 200 mm	020
5.0 m ± 500 mm	050

Total system length (H) ²	
05	5 m
10	10 m

Flexible hose length (G) ¹	
Each 0.1 m, from 0.0 to 4.8 m. G min. = C + 100 mm.	
000	None
001	0.1 m min.
048	4.8 m max.

Optional protection (F) ¹		
	Cable	Connector
0	None	None
1	Flexible hose	None
2	Flexible hose with sleeve	None
3	Movable flexible hose	None
4	Movable flexible hose with sleeve	None
5	None	IP172
6	Flexible hose	IP172
7	Flexible hose with sleeve	IP172
8	Movable flexible hose	IP172
9	Movable flexible hose with sleeve	IP172

Notes

All dimensions are in mm unless otherwise stated.

1. When optional protection such as a flexible stainless steel hose with or without a heat-shrinkable sleeve is ordered:

Flexible hose length (G) min. = Body length (C) + 100 mm.

Flexible hose length (G) max. = Integral cable length (E) - 200 mm, for an integral cable that is protected to the maximum extent possible ("cable fully covered").

2. The Total system length (H) = TQ401 integral cable length (E) + EA401 extension cable length.


For information on combining integral and extension cables to obtain a particular total system length, see **Total system (chain) length on page 7**.

For information on cable length tolerances, see

Total system (chain) length trimming on page 7.

MECHANICAL DRAWINGS AND ORDERING INFORMATION (continued)

EA401 extension cable

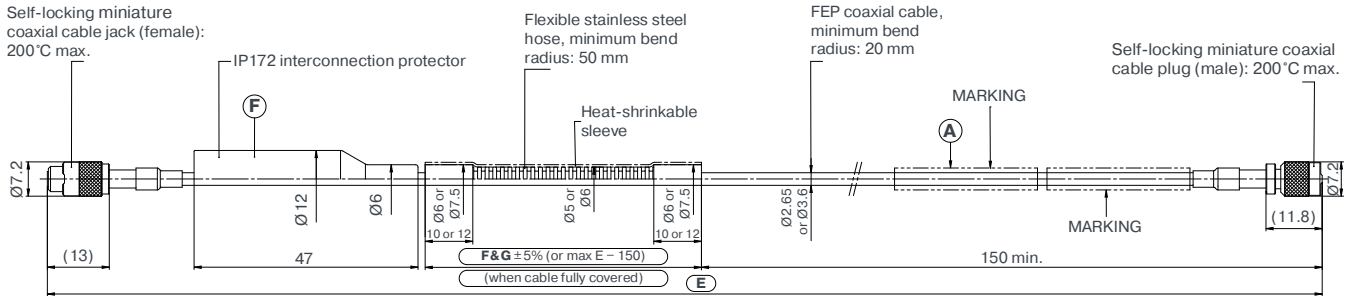

Ordering number: 913 - 401 - 000 - 013 - **A** - **E** - **F** - **G**

Environment (A)	
Standard	1
Explosive Ex i	2
Explosive Ex nA	3

Flexible hose length (G)	
Each 0.1 m, from 0 to 9.3 m	
000	None
001	0.1 m min.
093	9.3 m max.

Extension cable length (E) ¹			
5 m TSL	Ø2.65	3.0 m ±300 mm	030
		3.5 m ±350 mm	035
		4.0 m ±400 mm	040
		4.5 m ±450 mm	045
10 m TSL	Ø3.6	8.0 m ±1200 mm	080
		8.5 m ±1275 mm	085
		9.0 m ±1350 mm	090
		9.5 m ±1425 mm	095

Optional protection (F) ²		
Cable	Connector	
None	None	0
Flexible hose	None	1
Flexible hose with sleeve	None	2
None	IP172	5
Flexible hose	IP172	6
Flexible hose with sleeve	IP172	7

Notes

All dimensions are in mm unless otherwise stated.

1. The total system length = TQ401 integral cable length + EA401 extension cable length (E).

For information on combining integral and extension cables to obtain a particular total system length, see

Total system (chain) length on page 7. For information on cable length tolerances, see **Total system (chain) length trimming on page 7.**

2. When optional protection such as a flexible stainless steel hose with or without a heat-shrinkable sleeve is ordered:


Flexible hose length (G) max. = EA401 extension cable length (E) – 150 mm, for an extension cable that is protected to the

MECHANICAL DRAWINGS AND ORDERING INFORMATION *(continued)*


IQS900 signal conditioner

Side and top views

Note: All dimensions in mm (in) unless otherwise stated.

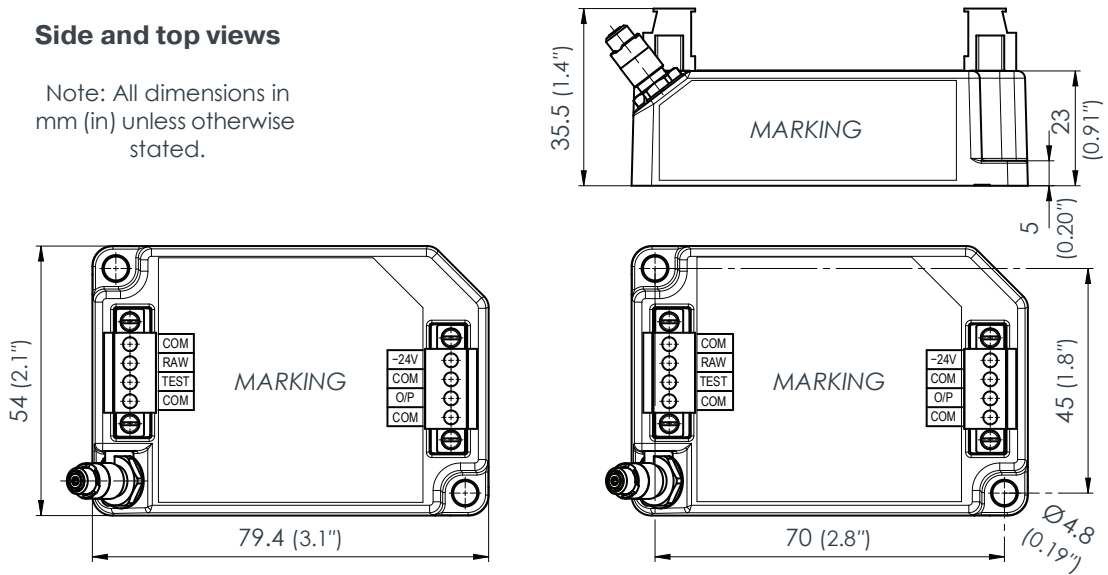

Side and end views with DIN-rail mounting adaptor (ordering option code G2)

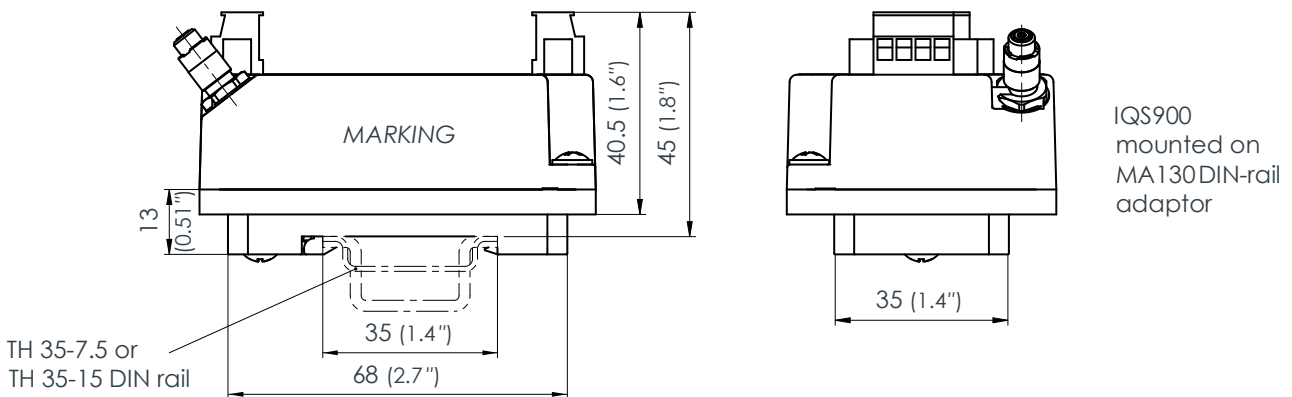

Ordering number: 204 - 900 - 000 - 011 - **A** - **B** - **C** - **H** - **I**

Environment (A) ¹	
Standard	1
Explosive (Ex)	5

Measurement range	Sensitivity (B)	
	2 mm	8 mV/ μ m
	2.5 μ A/ μ m	12

Diagnostics (C) ²	
Without diagnostics	1
With diagnostics (SIL)	2

Total system length (H)	
5 m	05
10 m	10

Installation (I)	
Without DIN-rail adaptor	0
With DIN-rail adaptor (MA130)	1

Notes: see following page.

MECHANICAL DRAWINGS AND ORDERING INFORMATION *(continued)*

IQS900 signal conditioner *(continued)*

Notes




1. Ordering option code A5 (“Ex”) specifies an IQS900 signal conditioner suitable for use in hazardous areas.
 - For an IQS900 signal conditioner with protection mode “Ex” located in an Ex Zone 2, the user must ensure that the IQS900 is installed in an industrial housing or enclosure that ensures a protection rating of at least IP54 (or equivalent).
2. Ordering option code C specifies an IQS900 signal conditioner either without diagnostics (C1) or with diagnostics (C2):
 - An IQS900 signal conditioner without diagnostics (C1) is similar to the IQS45x, which it replaces. The IQS900 is a form, fit and functionally equivalent replacement that matches or betters the measurement specifications of the IQS45x.
 - An IQS900 signal conditioner with diagnostics (C2) includes optional diagnostic circuitry that automatically detects and remotely indicates problems with the measurement chain (sensor, cabling and/or the IQS900 itself). An IQS900 with diagnostics is certified SIL 2 (IEC 61508) and PL c Cat 1 (ISO 13849) “by design” to more easily meet the requirements of safety-related applications. Contact Parker Meggitt. for further information.

ACCESSORIES

ABA17x	Industrial housings	: Refer to corresponding data sheet
IP172	Interconnection protection	: Refer to corresponding data sheet
JB118	Junction box	: Refer to corresponding data sheet
KS107	Flexible conduit (protection tube)	: Refer to corresponding data sheet
MA130	Mounting adaptor	: See below
SG1xx	Cable feedthroughs	: Refer to corresponding data sheets

ACCESSORIES (continued)

MA130 DIN-rail mounting adaptor

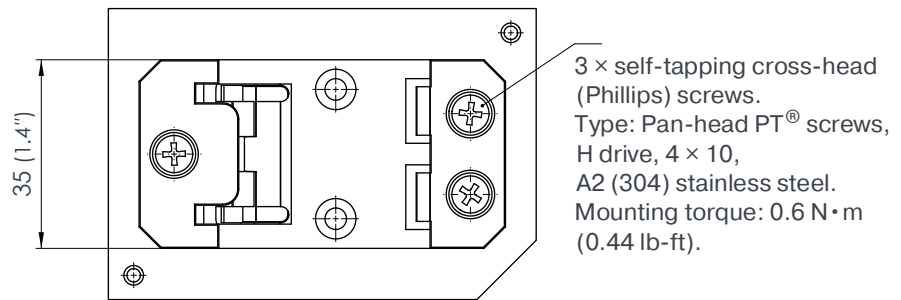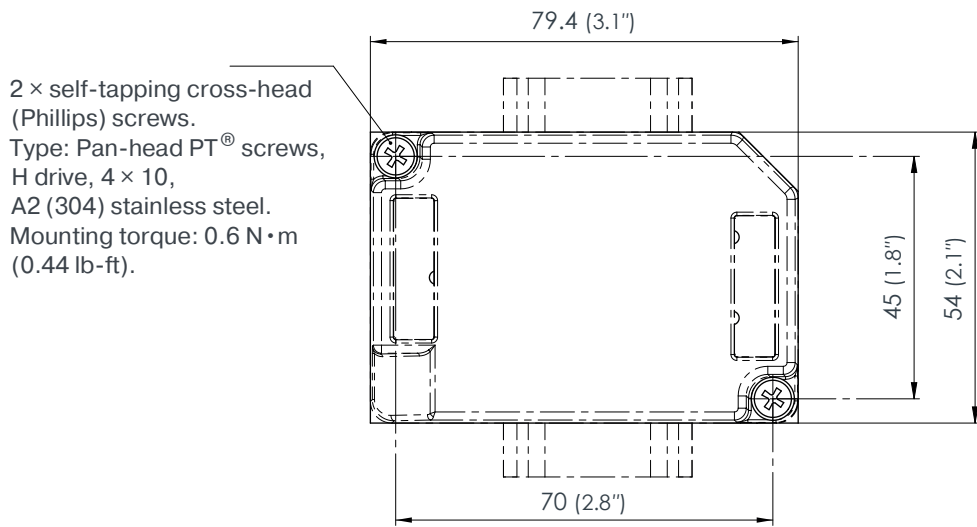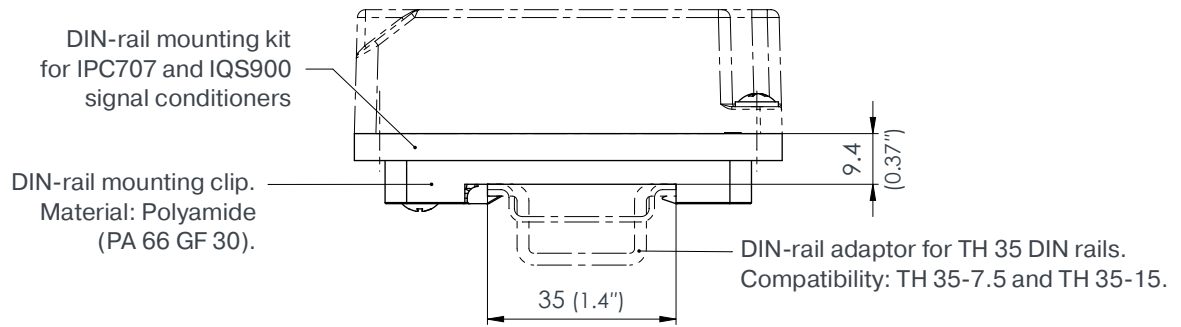

Note: All dimensions in mm (in) unless otherwise stated.

Ordering number (PNR): 809-130-000-021

RELATED PRODUCTS

TQ403, EA403 and IQS450	Proximity measurement system (12 mm measurement range)	: Refer to corresponding data sheet
TQ422/TQ432, EA402 and IQS450	Proximity measurement system (2 or 4 mm measurement range, high-pressure applications)	: Refer to corresponding data sheet
TQ423, EA403 and IQS450	Proximity measurement system (12 mm measurement range, high-pressure applications)	: Refer to corresponding data sheet
TQ442, EA402 and IQS450	Proximity measurement system (2 or 4 mm measurement range, right-angle (90°) mount)	: Refer to corresponding data sheet
TQ902/TQ912, EA902 and IQS900	Proximity measurement chains (2 or 4 mm measurement range)	: Refer to corresponding data sheet
TQ922/TQ932, EA902 and IQS900	Proximity measurement chains (2 or 4 mm measurement range, high-pressure applications)	: Refer to corresponding data sheet
TQ942, EA902 and IQS900	Proximity measurement chain (2 or 4 mm measurement range, right-angle (90°) mount sensor)	: Refer to corresponding data sheet
IQS910	Signal conditioner	: Refer to corresponding data sheet

Parker Hannifin Corporation – usually referred to as just Parker – is a global leader in motion and control technologies, providing precision-engineered solutions for a wide variety of mobile, industrial and aerospace markets. For more than a century the company has been enabling engineering breakthroughs that lead to a better tomorrow.

Parker Meggitt joined the Parker Aerospace Group in September 2022 following the successful acquisition of Meggitt PLC, a world leader in aerospace, defense and energy. This includes the Meggitt facility in Fribourg, Switzerland, operating as the legal entity Meggitt SA (formerly Vibro-Meter SA). Accordingly, the vibro-meter® product line is now owned by Parker.



All information in this document, such as descriptions, specifications, drawings, recommendations and other statements, is believed to be correct and reliable. Although given in good faith, the accuracy and/or completeness of such data is not guaranteed or legally binding on Parker Meggitt (Meggitt SA) and we reserve the right to alter any part of this document/publication without prior notice. Before acquiring and/or using this product, you should evaluate it and determine if it is suitable for your intended application. You should also check our website at www.meggittsensing.com/energy to ensure that the latest versions of documentation are being used. For example, data sheets, certificates, product drawings, user manuals, service bulletins and/or other instructions affecting the product.

Unless expressly agreed in writing with Parker Meggitt, you assume all risks and liability associated with use of the product. Any recommendations and advice given without charge, whilst given in good faith, are not legally binding. We take no responsibility for any statements related to the product which are not contained in a current Parker Meggitt publication, nor for any statements contained in extracts, summaries, translations or any other documents not authored and produced by us.

The certifications and warranties applicable to the products supplied by Parker Meggitt are valid only for new products purchased directly from us or an authorized distributor.

In this publication, a dot (.) is used as the decimal separator and thousands are separated by thin spaces. Example: 12345.67890.

Copyright © 2025 Parker Meggitt. All rights reserved.

Sales offices and distributors

Parker has sales offices and distributors all around the world. For information on your local contact, please visit our website.



Local representative

Parker Meggitt (Meggitt SA) office

Parker Meggitt,
Motion, Power & Sensing Division (MPSD).
Meggitt SA, Route de Moncor 4, Case postale,
1701 Fribourg, Switzerland.
www.meggittsensing.com/energy
www.meggitt.com
www.parker.com